



STANDARD DESIGN CROSSING TILE

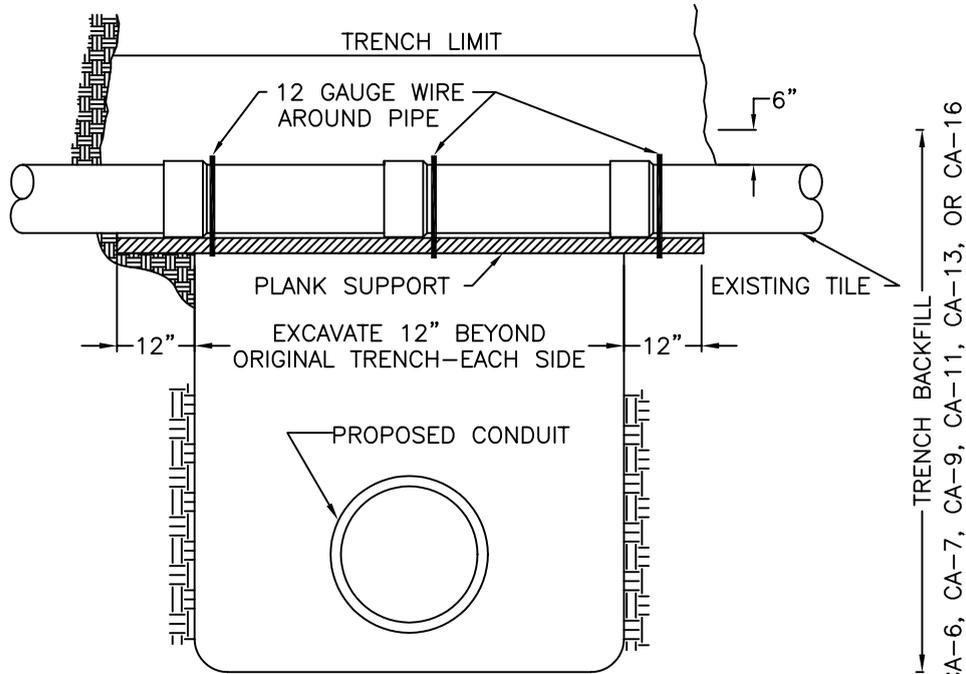

CROSS SECTION DETAIL-CROSSED TILE

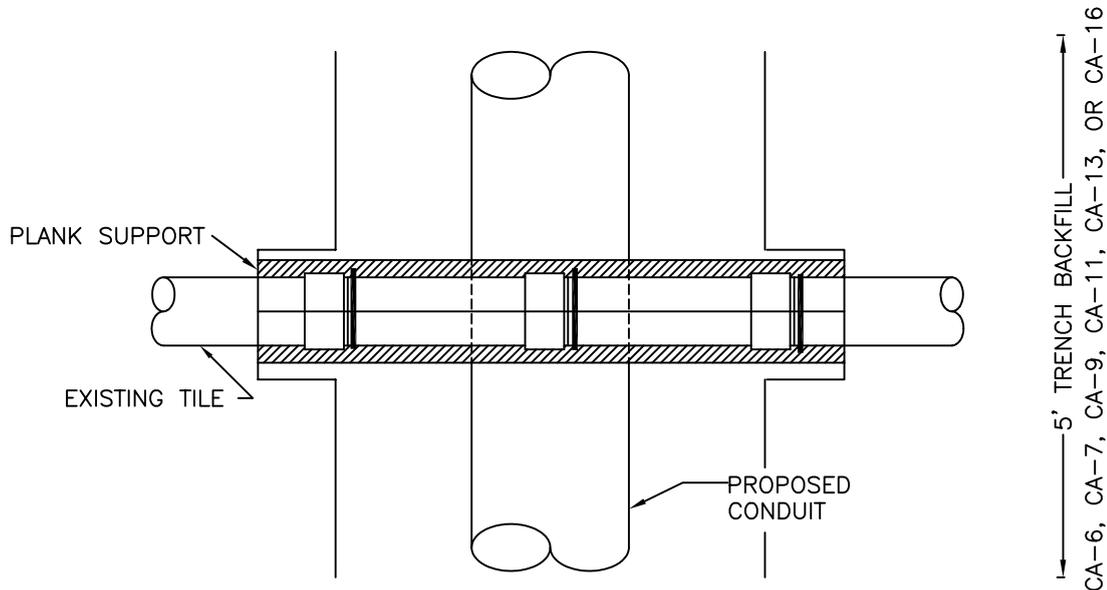

PLAN SECTION DETAIL-CROSSED TILE

NOTES:

1. ABOVE DETAIL APPLIES WHEN EDGE OF TRENCH IS GREATER THAT 2' BEYOND ANY PAVED SURFACE. WHEN TILE IS CROSSED AND EDGE OF TRENCH IS 2' OR LESS FROM ANY PAVED SURFACE, STANDARD #2050 AND PLANK SUPPORT DETAIL SHALL APPLY.
2. THE PLANK SUPPORT SHALL BE A MINIMUM 2" NOMINAL THICKNESS AND 4" WIDER THAN THE DIAMETER OF THE SUPPORTED PIPE. MORE THAN ONE PLANK MAY BE USED, BUT NO PLANK SHALL BE LESS THAN 8".
3. THE SUPPORT PLANK MUST REST ON THOROUGHLY COMPACTED TRENCH BACKFILL THAT HAS BEEN PLACED BEFORE THE PLANK IS INSTALLED.
4. ALL JOINTS IN THE TRENCH AREA SHALL BE SEALED IN A MANNER APPROVED BY THE ENGINEER. MORTAR SHALL NOT BE USED.

CITY OF DECATUR, ILLINOIS DEPARTMENT OF ENGINEERING & INFRASTRUCTURE	ISSUED: 7-3-01 REVISIONS BY DATE K.G.Q. 4/6/00
ADOPTED JANUARY 1, 2003 DIRECTOR OF ENGINEERING & INFRASTRUCTURE	

STANDARD# 2090